



DOUBLE CHECK VALVE ASSEMBLY (DCVA)

3/4" & 1" VAULT

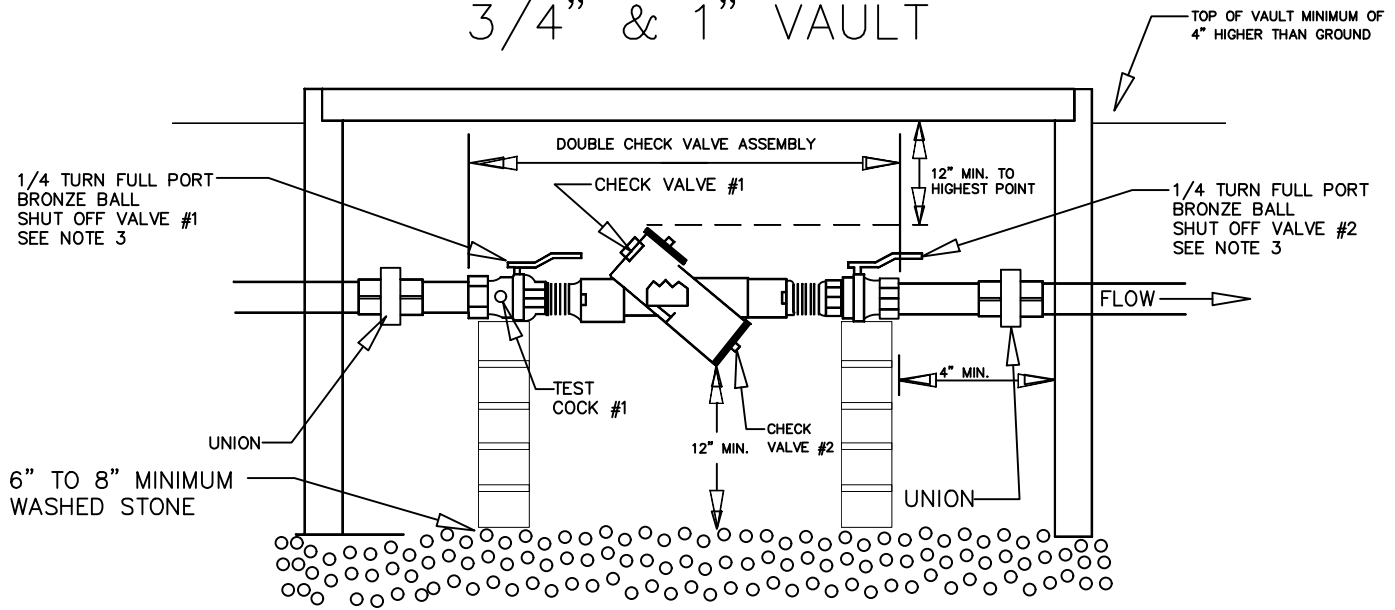

ELEVATION VIEW

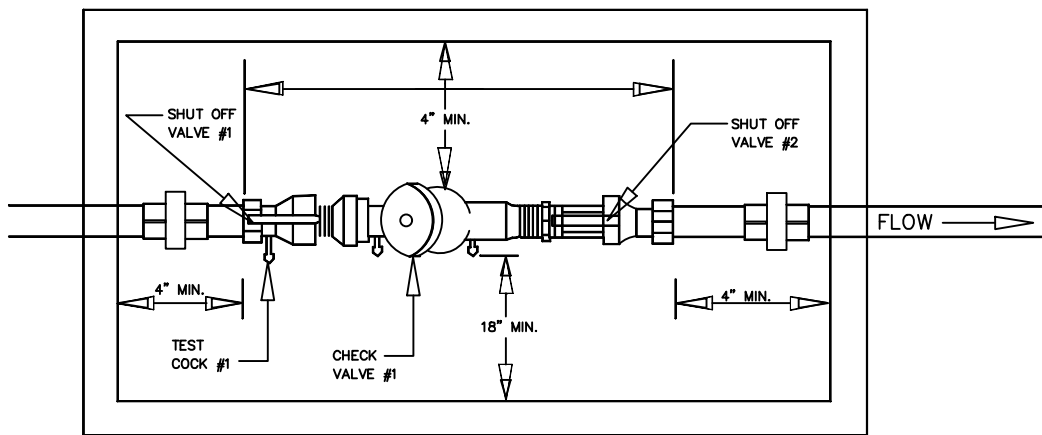

PLAN VIEW

NOTES:

1. DCVA MUST CONFORM TO SALISBURY-ROWAN UTILITIES SPECIFICATIONS FOR BACKFLOW PREVENTION ASSEMBLIES 3/4" & 1".
2. (BACKFLOW ASSEMBLY MUST BE INSTALLED BEFORE SERVICE LINE IS CONNECTED TO ANY OTHER PIPES, EXCEPT AS AUTHORIZED BY THE WATER PURVEYOR.) WATER LINE MUST BE EXPOSED FOR INSPECTION FROM METER TO BACKFLOW PREVENTER. CONNECTION TO CITY'S FITTING SHALL NOT BE INSIDE METER VAULT.
3. SALISBURY-ROWAN APPROVED DCVA'S INCLUDE SHUT OFF VALVES #1 AND #2. NO SUBSTITUTIONS SHALL BE PERMITTED.
4. TEST COCK #1 SHALL BE UPSTREAM OF SHUT OFF VALVE #1 AND IS TO BE PART OF THE APPROVED ASSEMBLY. ALL TEST COCKS MUST BE ON THE SIDE OR TOP. ASSEMBLIES SHALL BE INSTALLED UPRIGHT AND IN THE HORIZONTAL POSITION.
5. VAULT, DOORS, COVERS, AND SUPPORT OF ASSEMBLY SHALL BE DESIGNED BY OWNER AS REQUIRED.

CITY OF SALISBURY, N.C. STANDARD DETAIL	DATE: OCTOBER 17, 2006 AMENDED: FEBRUARY 3, 2009
STANDARD DETAIL BACKFLOW PREVENTION 3/4" & 1" VAULT (DCVA)	NOT TO SCALE STANDARD BF-3