


WHEELCHAIR RAMP IN VERTICAL CURB & GUTTER

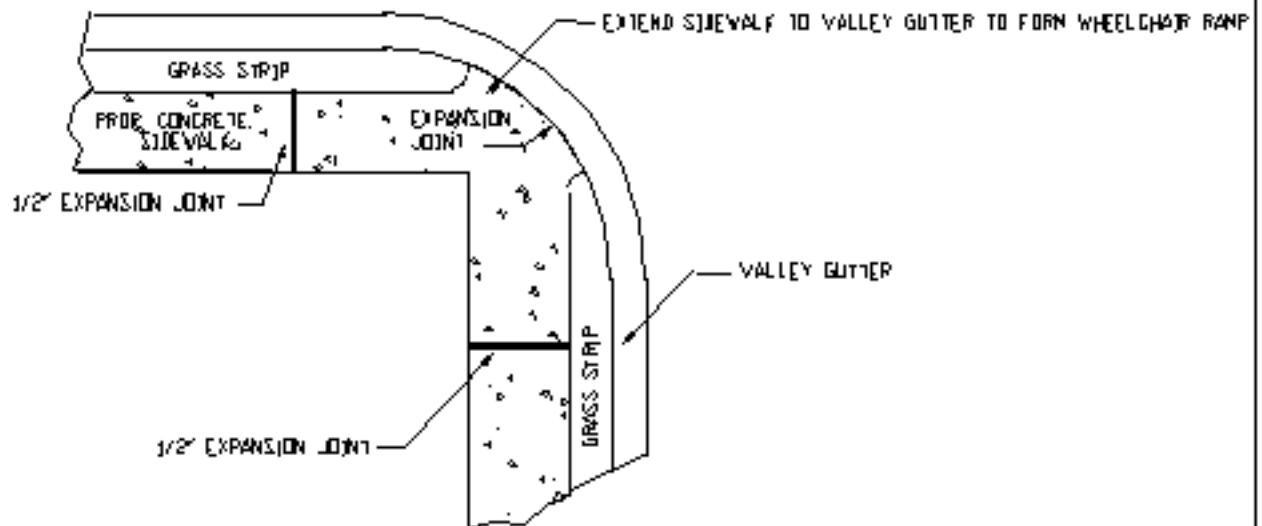

WHEELCHAIR RAMP IN VALLEY GUTTER

GENERAL NOTES:

1. A GROOVE JOINT 1" DEEP WITH 1/2" RADIUS SHALL BE REQUIRED IN THE CONCRETE SIDEWALK AT 5' INTERVALS. ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT 45' INTERVALS. A 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.
2. WHEELCHAIR RAMPS SHALL HAVE 6" THICK CONCRETE.

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: APRIL 17, 2001

ROADS  
WHEELCHAIR RAMPS

NOT TO SCALE

STANDARD

R-12