


PLAN

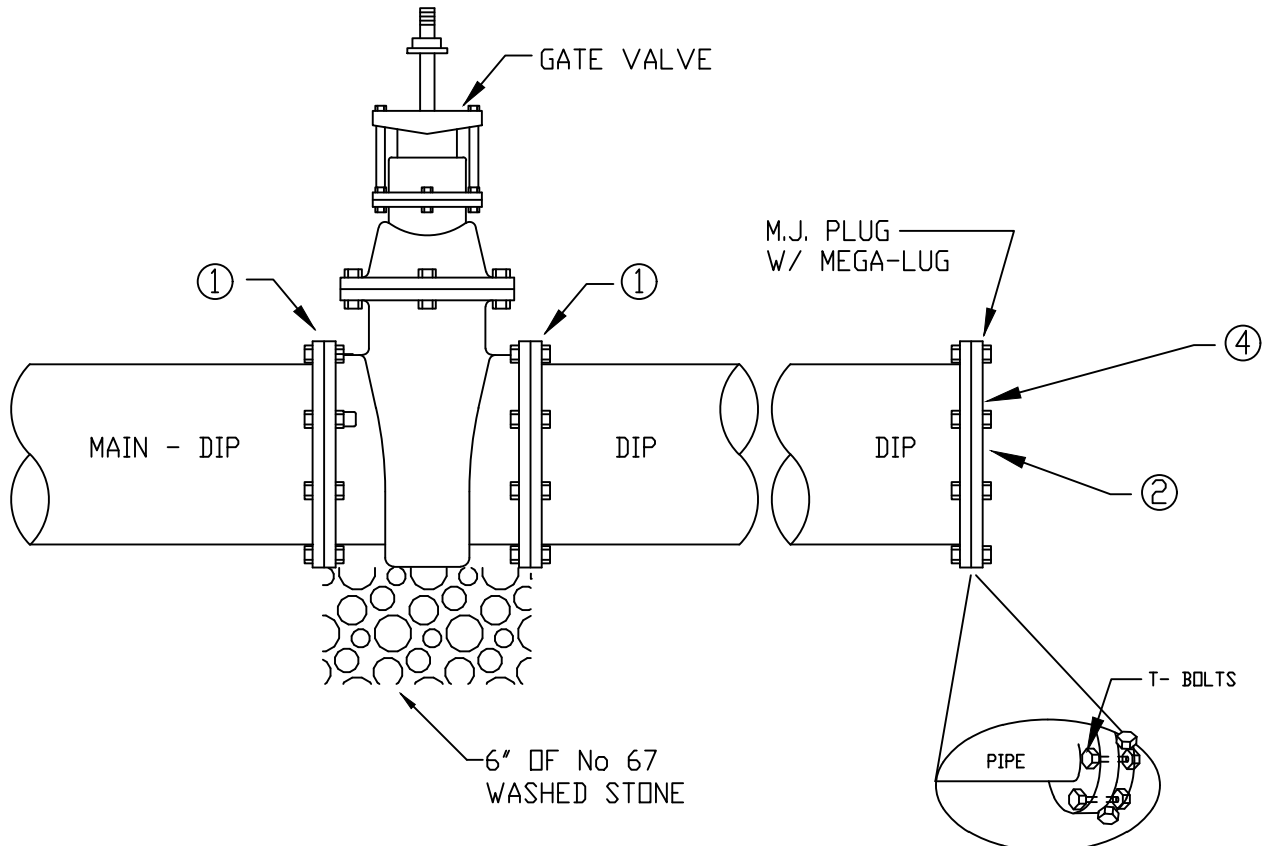

- ① RETAINER GLAND (MEGA-LUGS OR GRIP RINGS ONLY) FOR DUCTILE IRON PIPE. PROVIDE RETAINER GLAND FOR EACH MECHANICAL JOINT FITTING (TEE, VALVE, BEND)
- ② M.J. PLUG WITH THREADED HOLE FOR 2" BLOW-OFF PIPE OR M.J. REDUCER FOR BLOW-OFFS LARGER THAN 2".
- ③ IF REQUIRED BY FIRE MARSHALL OR FIRE DEPARTMENT.
- ④ BLOW-OFF REQUIRED AT END OF LINE. SEE STANDARD DETAIL W-7.

CITY OF SALISBURY, N.C. STANDARD DETAIL	DATE: APRIL 19, 2011
WATER SYSTEMS DEAD END LINES	AMENDED: JULY 19, 2022
	NOT TO SCALE
	STANDARD W-6