


SECTION

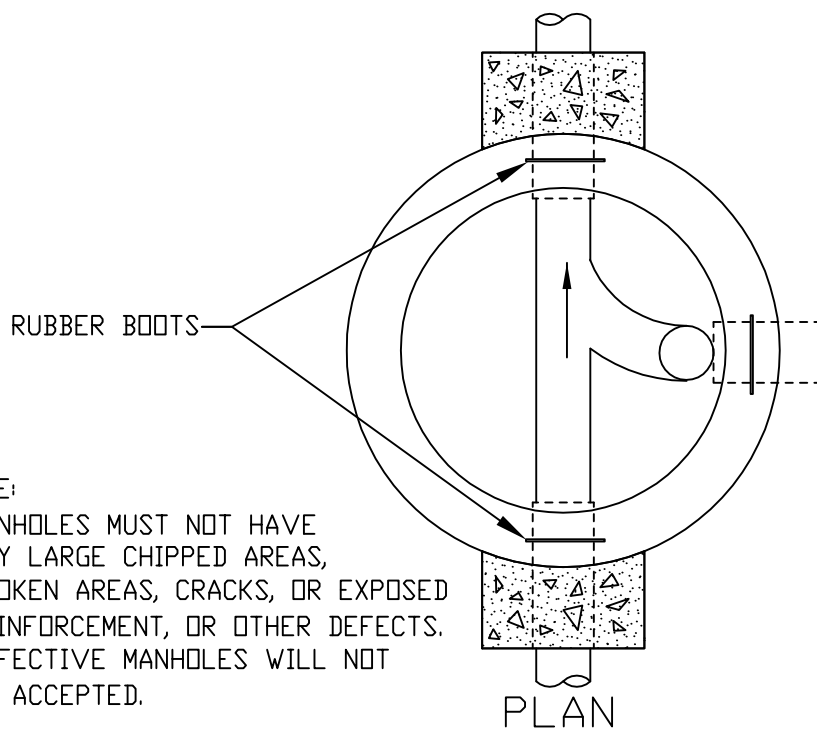

NOTES:

1. INSIDE DROPS TO BE USED FOR PIPE 12" AND SMALLER
2. MINIMUM MANHOLE DIAMETER IS 5'
3. DROPS REQUIRED WHERE INVERT IN IS 2' OR MORE ABOVE INVERT OUT
4. TEE BRANCH THE SAME SIZE AS MAIN LINE
5. SEE SS-1 FOR ADDITIONAL MANHOLE DIMENSIONS
6. NO LATERALS OR CORES IN CONE SECTION
7. WRAP OUTSIDE MANHOLE SEAMS
8. 5' INSIDE DIAMETER MANHOLES SHALL HAVE 6" THICK WALLS

NOTE:

MANHOLES MUST NOT HAVE ANY LARGE CHIPPED AREAS, BROKEN AREAS, CRACKS, OR EXPOSED REINFORCEMENT, OR OTHER DEFECTS. DEFECTIVE MANHOLES WILL NOT BE ACCEPTED.

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: OCTOBER 17, 2006  
AMENDED: MAY 19, 2009

SEWER SYSTEMS  
PRECAST M.H. WITH INSIDE DROP

NOT TO SCALE

STANDARD SS-2