


Ⓐ 4' INSIDE DIAMETER MANHOLES SHALL HAVE 5" THICK WALLS
 5' INSIDE DIAMETER MANHOLES SHALL HAVE 6" THICK WALLS

SECTION

- NOTES:
1. MANHOLE TO CONFORM WITH ASTM C478 OR LATEST REVISION
 2. ALL JOINTS SHALL CONFORM WITH ASTM C443.
 3. STEPS TO BE PLASTIC PER CITY STANDARDS.
 4. BUTYL RUBBER SEALANT TO MEET FEDERAL SPECIFICATION (GSA-FSS) SS-S-00210.
 5. 48" DIA. M.H., PIPES 8"-18"
60" DIA. M.H., PIPES 20"-30"
 6. MANHOLES WITH A DEPTH OF 10' OR GREATER MUST BE 5' DIAMETER
 7. ALL MANHOLES ARE REQUIRED TO BE VACUUM TESTED.
 8. NO LATERALS OR CORES IN MANHOLE CONE SECTION.
- FLOOR HARDENER ON BENCH WALLS & INVERT-MIN. 1/2" THICKNESS

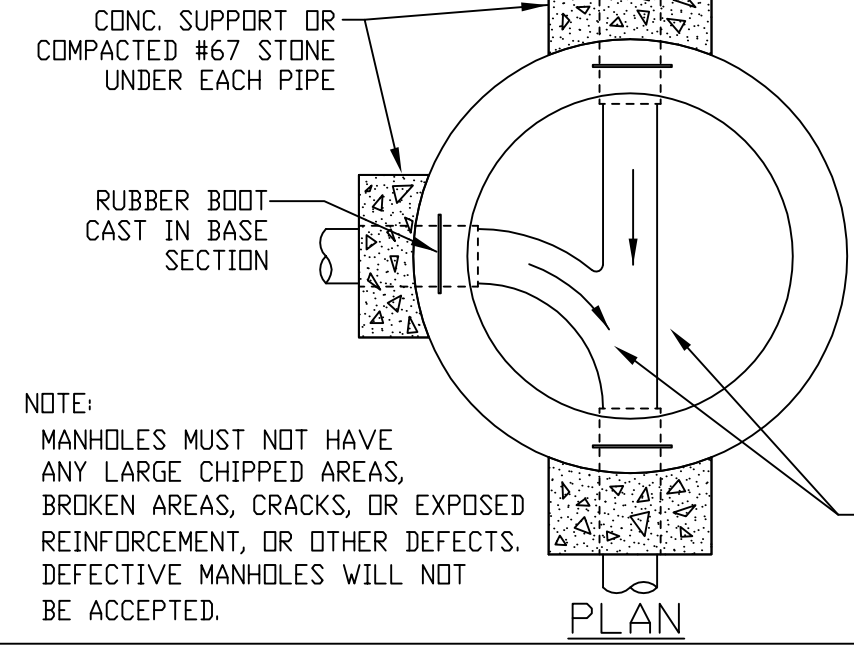

CITY OF SALISBURY, N.C. STANDARD DETAIL SEWER SYSTEMS PRECAST MANHOLE	DATE: OCTOBER 17, 2006 AMENDED: MAY 19, 2009
	NOT TO SCALE STANDARD SS-1