




2'-6" CURB AND GUTTER

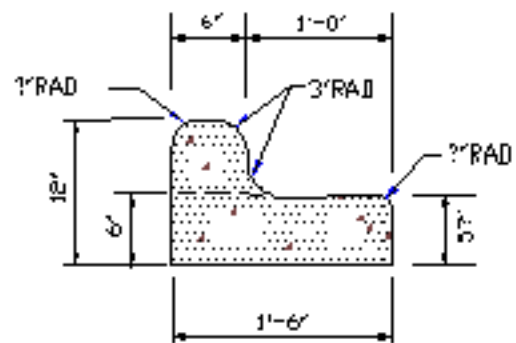

1'-6" CURB AND GUTTER

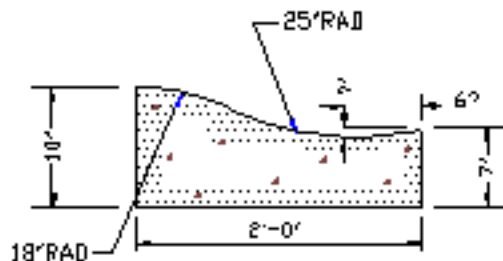

2'-0" VALLEY GUTTER

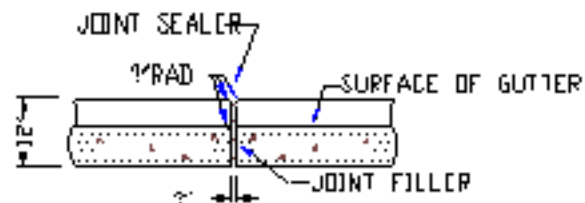

TRANSVERSE EXPANSION JOINT  
IN CURB AND GUTTER

GENERAL NOTES:

1. CONTRACTION JOINTS SHALL BE SPACED AT 10 FOOT INTERVALS, EXCEPT THAT A 15 FOOT SPACING MAY BE USED WHEN A MACHINE IS USED OR WHEN SATISFACTORY SUPPORT FOR THE FACE CAN BE OBTAINED WITHOUT THE USE OF TEMPLATES AT 10 FOOT INTERVALS.
2. JOINT SPACING SHALL BE PROVIDED TO PREVENT UNCONTROLLED CRACKING.
3. CONTRACTION JOINTS MAY BE INSTALLED BY THE USE OF TEMPLATES OR FORMED BY OTHER NCDOT APPROVED METHODS, WHERE SUCH JOINTS ARE NOT FORMED BY TEMPLATES, A MINIMUM DEPTH OF 1" SHALL BE OBTAINED.
4. ALL CONTRACTION JOINTS SHALL BE FILLED WITH JOINT SEALER.
5. EXPANSION JOINTS SHALL BE SPACED AT 90 FOOT INTERVALS, AND ADJACENT TO ALL RIGID OBJECTS.

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: JANUARY 1, 1991

ROADS  
CURB AND GUTTER

NOT TO SCALE

STANDARD

R-7