
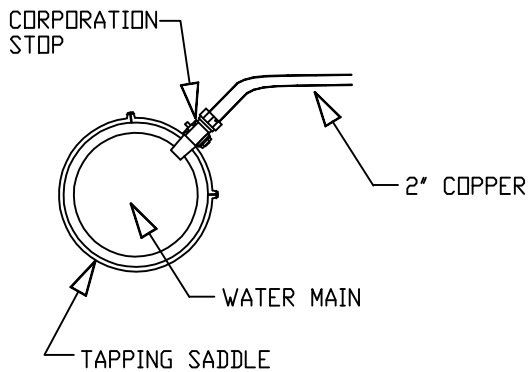


COPPERSETTER FOR 2" FLANGED METER

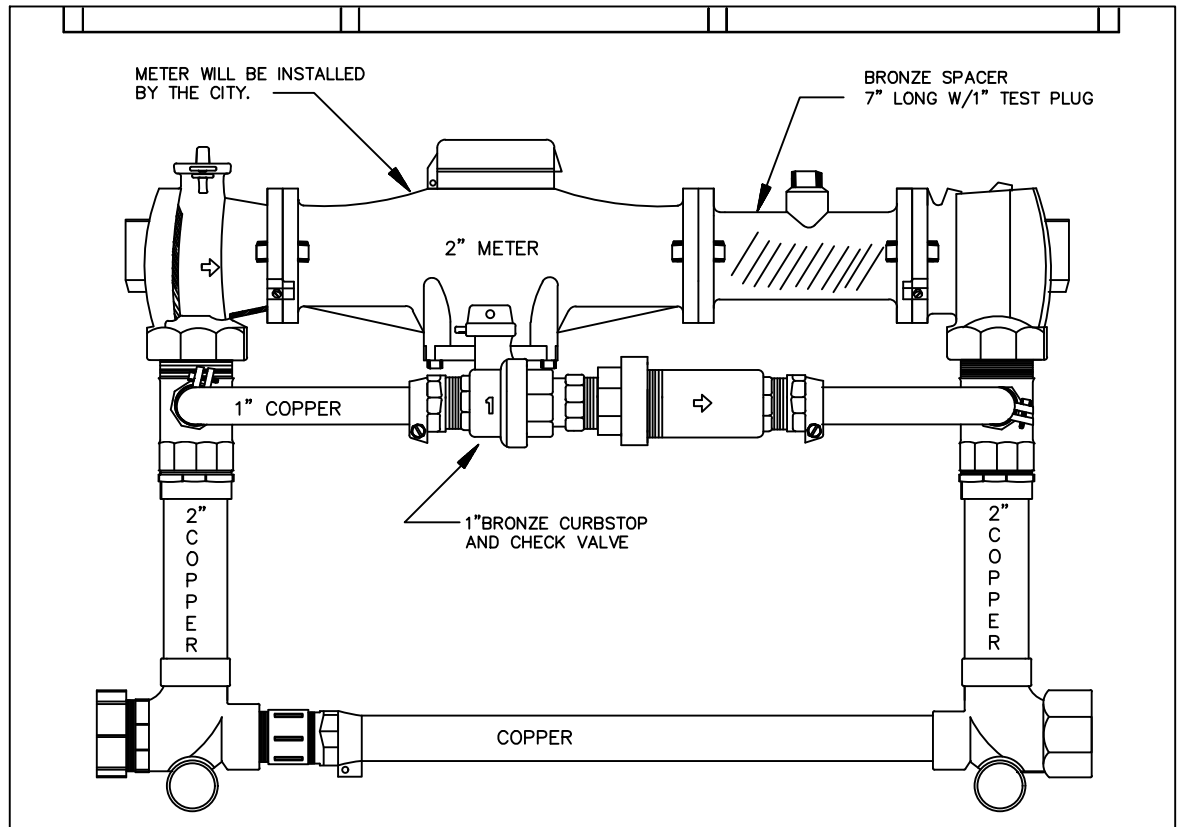

1. BY-PASS INCLUDES A BALL VALVE WITH PADLOCK WINGS.
2. BRACE PIPE EYELETS ARE STANDARD—BRACE PIPE NOT INCLUDED.
3. INLET IS COPPER TUBE PACK JOINT
4. OUTLET IS FEMALE IRON PIPE THREADS.
5. OUTLET SIDE WILL ALSO HAVE 2"X24" BRASS NIPPLE AND A 2" HAMMOND 606 GATE VALVE. METER BOX SHALL BE THE SAME AS USED FOR 1" METER.
6. SEE CURRENT APPROVED PRODUCT MANUFACTURERS SHEET FOR APPROVED TYPES. (APPENDIX "A")

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: JANUARY 1, 1991
 AMENDED: MAY 19, 2009

WATER SYSTEMS
 2 " METER CONNECTION

NOT TO SCALE

STANDARD W-10