


TEMPORARY BACKFLOW PREVENTION DEVICE (RP)

Backflow Device	A
4"	6' 3"
6"	9'
8"	11' 2"

Water Main Size	B
6"	17"
8"	19"
12"	22"
16"	26"
24"	32"

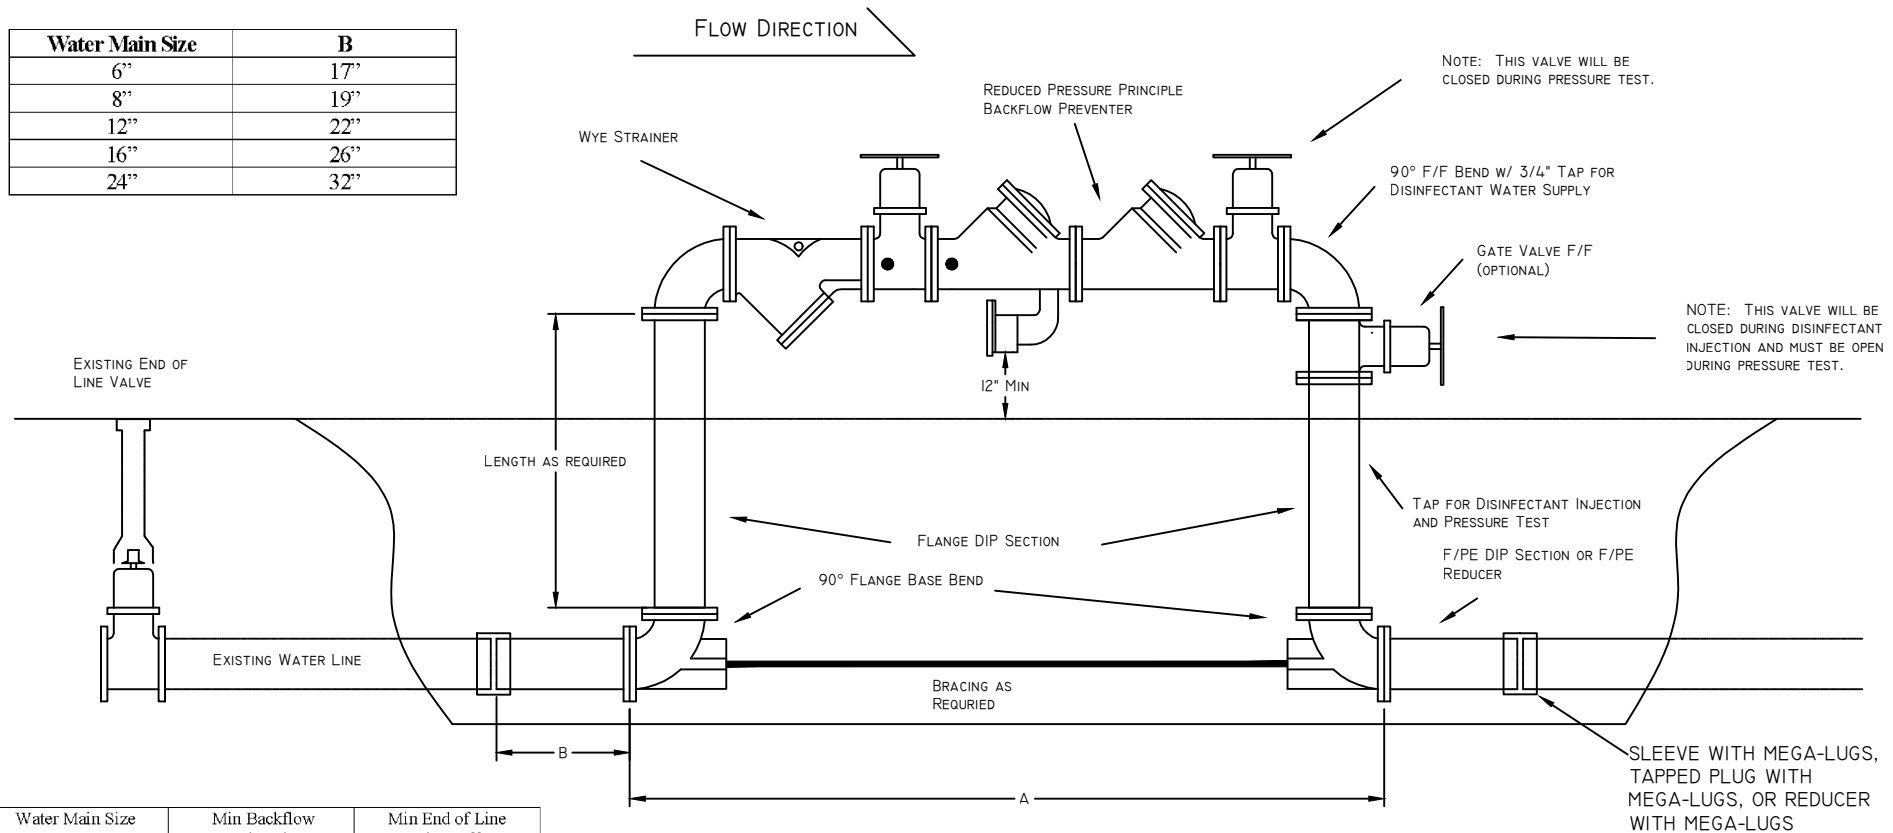

Water Main Size	Min Backflow Device Size	Min End of Line Blow-off
2"	2"	2"
6" to 12"	4"	2"
16"	6"	4"
24"	8"	6"

NOTE: ALL PIPE INSTALLED BETWEEN THE EXISTING WATER LINE AND THE RP SHALL BE RESTRAINED JOINT PIPE. 2" RP PIPING SHALL BE COPPER AND/OR BRASS.

TEMPORARY BACKFLOW PREVENTION DEVICE (RP) - ONLY TO BE REMOVED AFTER CONSTRUCTION AND TESTING IS COMPLETE (AS DIRECTED BY SRU INSPECTOR)

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: MAY 19, 2009
 AMENDED: JULY 19, 2022

TEMPORARY BACKFLOW PREVENTION DEVICE
 FOR FILLING NEW LINES

NOT TO SCALE

STANDARD W-13