


# TEMPORARY BACKFLOW PREVENTION DEVICE (RP)

Backflow Device	A
4"	6' 3"
6"	9'
8"	11' 2"

Water Main Size	B
6"	17"
8"	19"
12"	22"
16"	26"
24"	32"

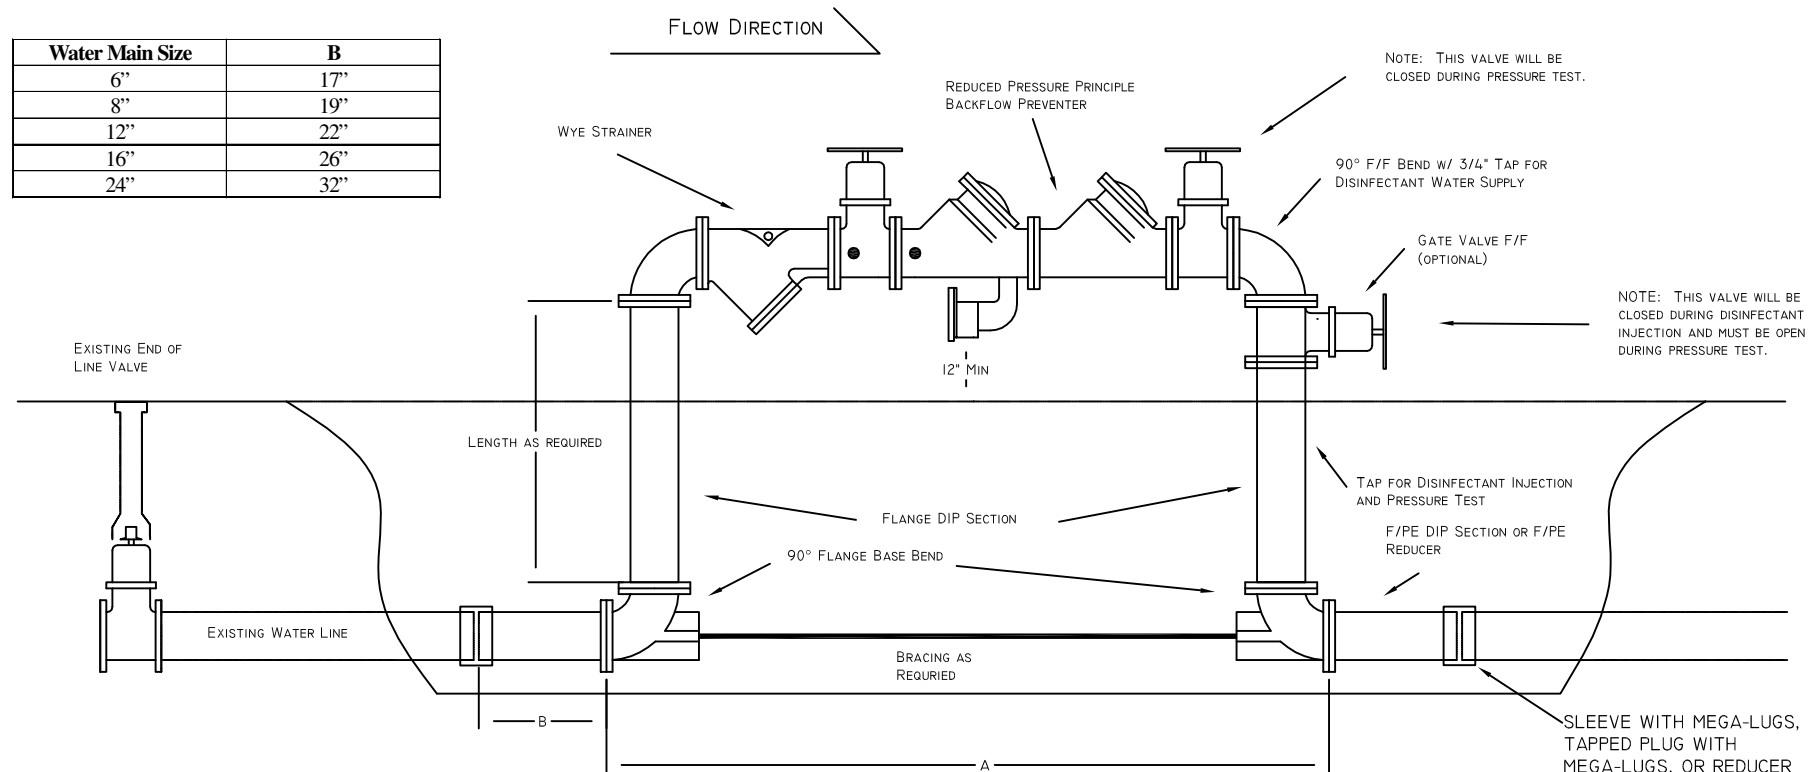

Water Main Size	Min Backflow Device Size	Min End of Line Blow-off
6" to 12"	4"	2"
16"	6"	4"
24"	8"	6"

NOTE: ALL PIPE INSTALLED BETWEEN THE EXISTING WATER LINE AND THE RP SHALL BE RESTRAINED JOINT PIPE.

TEMPORARY BACKFLOW PREVENTION DEVICE (RP) - TO BE REMOVED AFTER CONSTRUCTION IS COMPLETE (AS DIRECTED BY CITY INSPECTOR).

CITY OF SALISBURY, N.C.      STANDARD DETAIL

DATE:      OCTOBER 17, 2006  
 AMENDED:      MAY 19, 2009

TEMPORARY BACKFLOW PREVENTION DEVICE  
 FOR FILLING NEW LINES

NOT TO SCALE

STANDARD      W-13